

NORLYS VANSBRO 1920


AC 220-240V 50-60Hz | IP 55 | IK 09 | E27

Vansbro 1920XX0010
01.10.2026 v.10.10
www.norlys.no



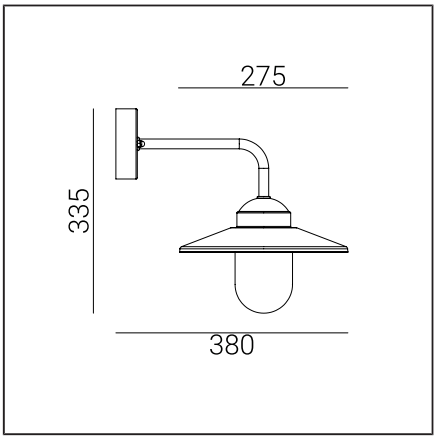

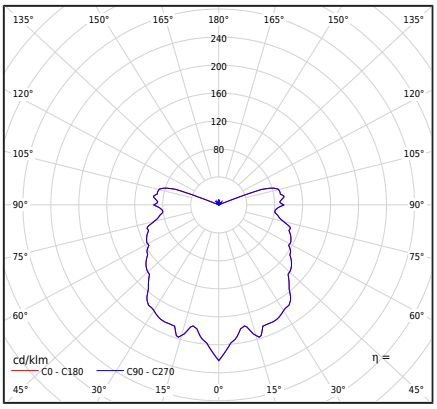

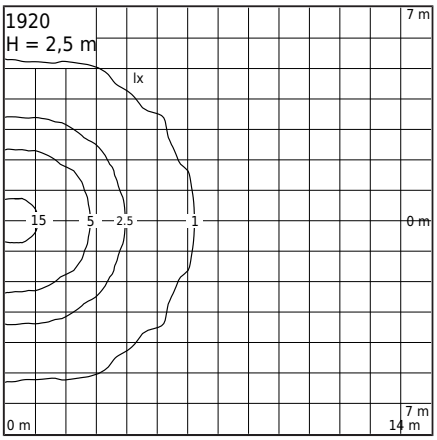

Type of luminaire

Type of luminaire	Wall light,
Photometric body	Uncovered light, partly covered from the top.
Characteristics of the luminaire	Scandinavian design wall-mounted luminaire. Possibility to install on corners of architectural objects.

General information

Materials	Hot-dip galvanized steel. Natural Copper. Powder painted steel. Lens - clear polycarbonate, UV stabilized. EPDM cable gland.
Mounting method	Fixing the luminaire: using the attached mounting box.
Terminal	Connection terminals: max 2x2,5mm², possibility to connect luminaire in loop max 2x1,5mm². A round wire in the isolation with a diameter of max ø7...10,5mm.
Type of light source	Lamp E27 A55...A60 Replaceable light source by an end-user.
Luminaire weight net / gross	1,39kg / 1,91kg
Box dimensions [cm]	41cm x 30,5cm x 24,5cm

Technical data

Lamp E27	LED A55..60
Light source wattage	LED max 9W
ULOR	20,5%
Ta Rated temperature	+25°C
Ambient operating temp. range	-20...+45°C
The option to order the fixture with the E27 LED lamp type Philips Master LEDbulb 806lm/8.5W/2700K (dimmable).	
BUG rating	B0-U3-G1

Accessories sold separately

153XX0009	Corner bracket

Spare parts

06240003	Lampshade - service kit

Files to download

Photometric LDT files	Photometric IES files
Manual	

Indexes

Index	Color	RAL
1920BL	BLACK	9005
1920CO	COPPER	-
1920GA	HOT-DIP GALVANIZING	-

Other colors according to the "Colors Template" / RAL pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED — Management System ISO 9001:2015 IATF 16949:2016 — www.tuv.com ID 9108651873

PCC Cert CERTIFICATE ISO 14001

RoHS 2011/65/UE

Please read the manual before installing. Due to the dynamic development of lighting technology, additional information is available upon request. LED module must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire.