

NORLYS STOCKHOLM 283


AC 220-240V 50-60Hz | IP 54 | E27

Stockholm
283XX0309
16.09.2026 v.09.8
www.norlys.no



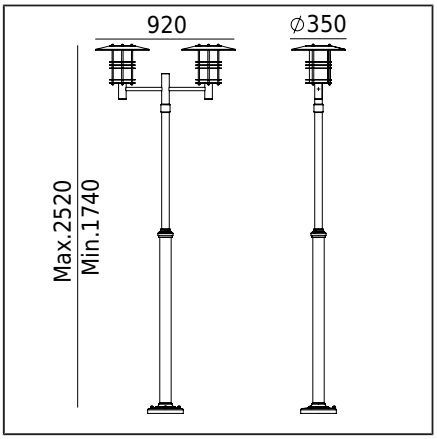

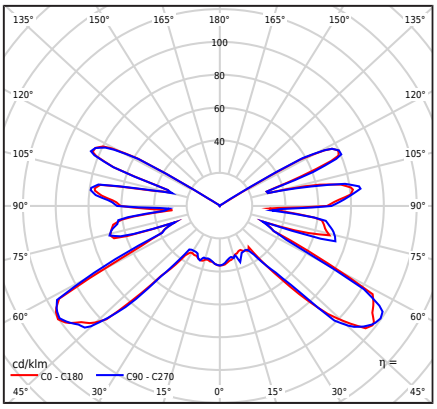

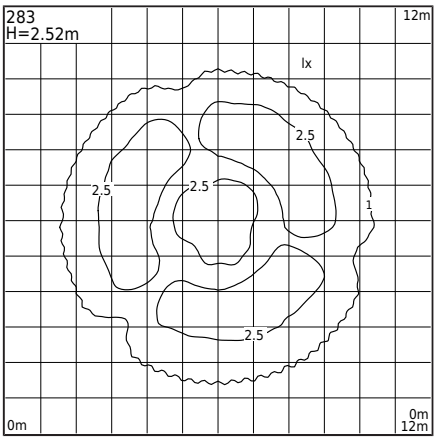

Type of luminaire

Type of luminaire	Pole luminaire.
Photometric body	Light discovered
Characteristics of the luminaire	Pole top luminaire in scandinavian design. For installation on a lighting pole with adjustable height 1740...2520mm. For lighting gardens, parks, and any other architectural concepts.

General information

Materials	Hot-dip galvanized steel. Powder painted steel. Lens - transparent plastic PMMA.
Mounting method	Mounting of the fixture: 3 holes ø10.5mm on a diameter of ø207mm spaced at 120°. Set composition: art.2018 - lighting fixture art. 3009/3011 - lighting post. Other accessories should be ordered separately.
Terminal	Connection terminals: max 4x2.5mm². Cable in a round sheath with a maximum diameter of ø12 mm.
Type of light source	Lamp E27 A55...A60
Luminaire dimensions [cm]	35cm x 92cm x 252cm

Technical data

Lamp E27	LED A55..60
Light source wattage	LED max 2x 9W
Luminaire wattage	LED max 2x 9W
ULOR	34,68%
Ta Rated temperature	+25°C
Ambient operating temp. range	-20...+45°C
BUG rating	B0-U3-G1

Accessories sold separately

405ZX0009	Concreting anchor
111GA0012	Adapter for concrete foundation
406ZX0009	Ground anchor

Spare parts

06281002	Lampshade - service kit
08281001	Gasket.

Files to download

Photometric LDT files — Photometric IES files

Indexes

Index	Color	RAL
283BL	BLACK	9005
283GA	HOT-DIP GALVANIZING	-

Other colors according to the "Colors Template" pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED — Management System ISO 9001:2015 IATF 16949:2016 — www.tuv.com ID 9108651873

PCC cert CERTIFICATE ISO 14001

RoHS 2011/65/UE

Please read the manual before installing. Due to the dynamic development of lighting technology, additional information is available upon request. LED module must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire.